



R-1

Roof Assembly Current Assembly or Typical Roof Assembly

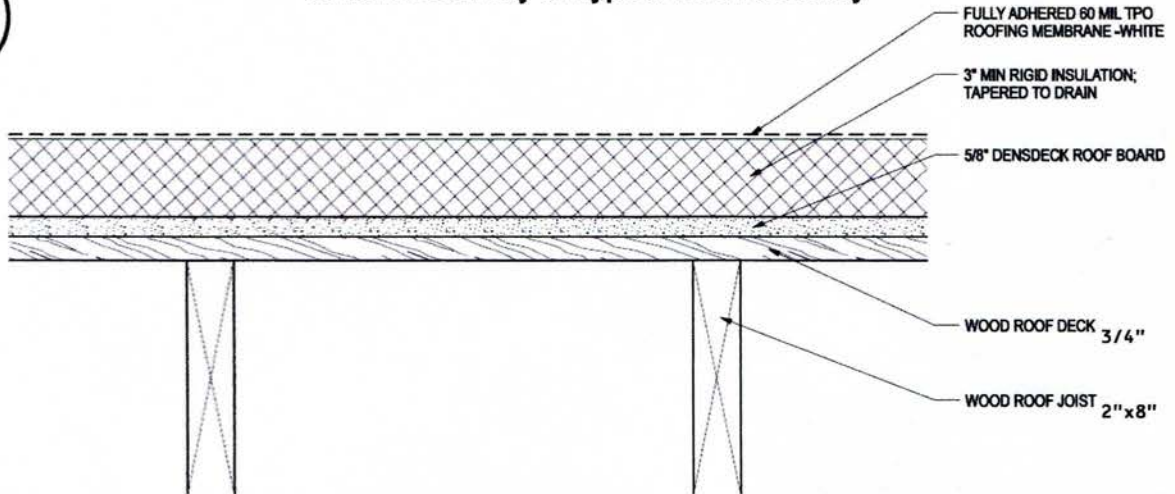

To achieve 1 Hr. Fire Rating Apply 30 mil (dry) thicknesses to the following areas:

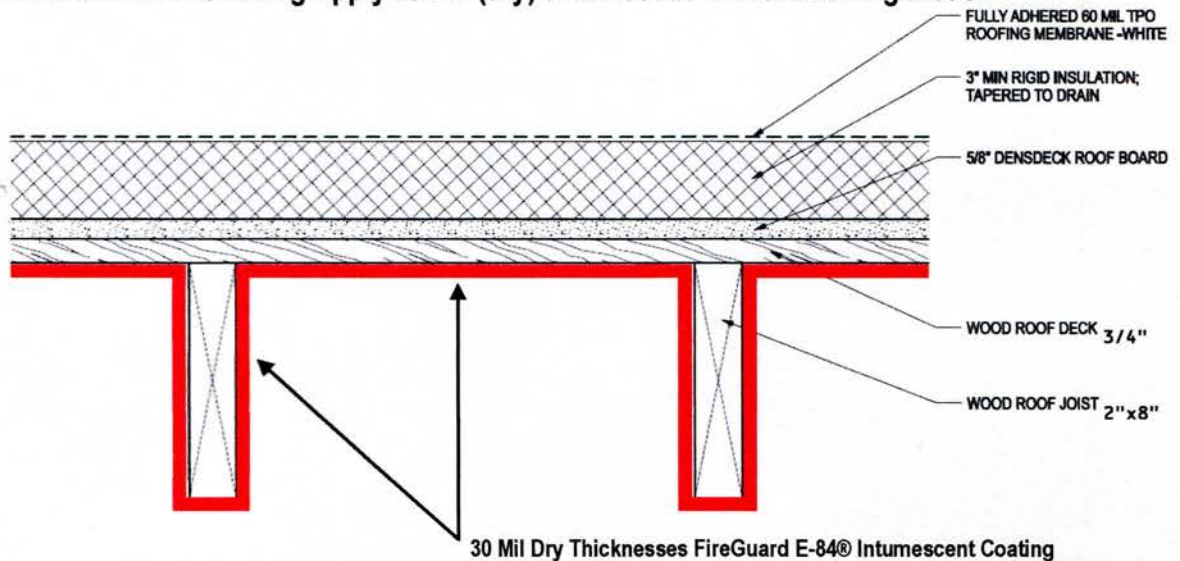

FIRE TEST ENDURANCE RATING:	1 Hour
STANDARD TESTED TO:	ASTM E-119
FIRE TESTED LABORATORY:	GUARDIAN FIRE TESTING LABORATORIES, INC. 480 HINMAN AVE. BUFFALO, NY 14213
REPORT NO:	GL 115411
PRODUCT:	ForceField® FireGuard® E-84 INTUMESCENT COATING (FFG E-84)
MANUFACTURER:	SHIELD INDUSTRIES, INC. 131 SMOKEHILL LANE WOODSTOCK, GA 30188
*SEE MANUFACTURER APPLICATION INSTRUCTIONS AND SPECIFICATIONS FOR SURFACE PREPERATION AND APPLICATION PROCESS	



Laura Ann Hinton
9/10/2013